
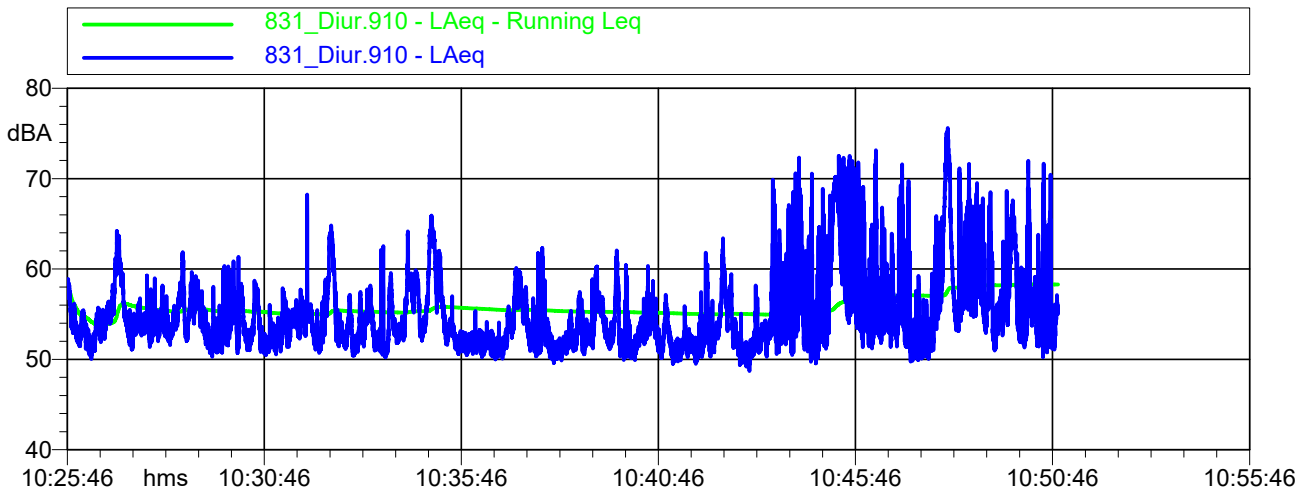


Nome misura: 831_Diur.910
Località: MARONE (BS)
Strumentazione: 831 0004327
Durata misura [s]: 1508.4
Nome operatore: DOTT. ANDREA BREVIARIO
Data, ora misura: 12/14/2021

831_Diur.910 - Lineare					
dB		dB		dB	
6.3 Hz	54.8 dB	100 Hz	55.1 dB	1600 Hz	46.2 dB
8 Hz	54.8 dB	125 Hz	53.3 dB	2000 Hz	46.4 dB
10 Hz	54.2 dB	160 Hz	52.4 dB	2500 Hz	42.9 dB
12.5 Hz	67.1 dB	200 Hz	53.0 dB	3150 Hz	45.4 dB
16 Hz	64.9 dB	250 Hz	52.8 dB	4000 Hz	39.2 dB
20 Hz	71.3 dB	315 Hz	51.3 dB	5000 Hz	35.4 dB
25 Hz	74.2 dB	400 Hz	51.6 dB	6300 Hz	33.6 dB
31.5 Hz	62.0 dB	500 Hz	53.0 dB	8000 Hz	28.9 dB
40 Hz	61.6 dB	630 Hz	50.7 dB	10000 Hz	24.5 dB
50 Hz	61.4 dB	800 Hz	47.6 dB	12500 Hz	22.7 dB
63 Hz	58.4 dB	1000 Hz	47.6 dB	16000 Hz	18.3 dB
80 Hz	56.1 dB	1250 Hz	46.8 dB	20000 Hz	20.0 dB

Valori statistici	
L1: 69.5 dBA	L90: 51.4 dBA
L5: 63.7 dBA	L95: 51.0 dBA
L50: 53.7 dBA	L99: 50.3 dBA

$L_{Aeq} = 58.3 \text{ dB}$

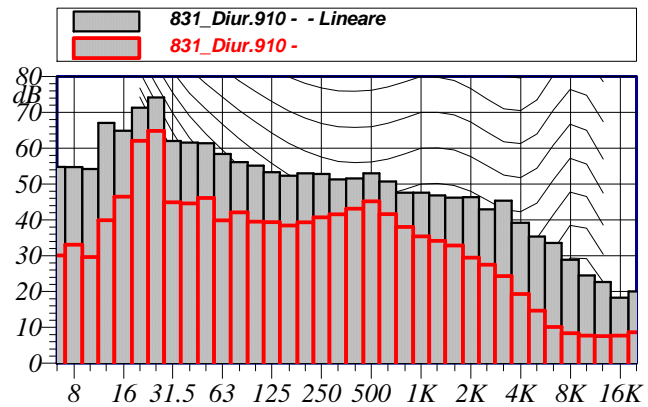



831_Diur.910 LAeq			
Nome	Inizio	Durata	Leq
Totale	10:25:46	00:25:08.400	58.3 dBA
Non Mascherato	10:25:46	00:25:08.400	58.3 dBA
Mascherato		00:00:00	0.0 dBA

Nome misura: 831_Diur.911
Località: MARONE (BS)
Strumentazione: 831 0004327
Durata misura [s]: 1177.5
Nome operatore: DOTT. ANDREA BREVIARIO
Data, ora misura: 12/14/2021

831_Diur.911 - Lineare					
dB		dB		dB	
6.3 Hz	56.8 dB	100 Hz	54.9 dB	1600 Hz	43.9 dB
8 Hz	56.5 dB	125 Hz	53.2 dB	2000 Hz	42.0 dB
10 Hz	55.3 dB	160 Hz	51.6 dB	2500 Hz	43.0 dB
12.5 Hz	59.7 dB	200 Hz	49.1 dB	3150 Hz	42.3 dB
16 Hz	72.5 dB	250 Hz	48.3 dB	4000 Hz	39.2 dB
20 Hz	71.0 dB	315 Hz	47.9 dB	5000 Hz	36.4 dB
25 Hz	73.7 dB	400 Hz	47.0 dB	6300 Hz	33.8 dB
31.5 Hz	61.4 dB	500 Hz	46.2 dB	8000 Hz	29.7 dB
40 Hz	59.9 dB	630 Hz	46.2 dB	10000 Hz	26.3 dB
50 Hz	59.0 dB	800 Hz	45.0 dB	12500 Hz	21.2 dB
63 Hz	56.9 dB	1000 Hz	45.1 dB	16000 Hz	16.0 dB
80 Hz	57.4 dB	1250 Hz	45.0 dB	20000 Hz	16.0 dB

Valori statistici	
L1: 64.0 dBA	L90: 51.0 dBA
L5: 58.9 dBA	L95: 49.9 dBA
L50: 52.6 dBA	L99: 46.3 dBA

$L_{Aeq} = 55.2$ dB

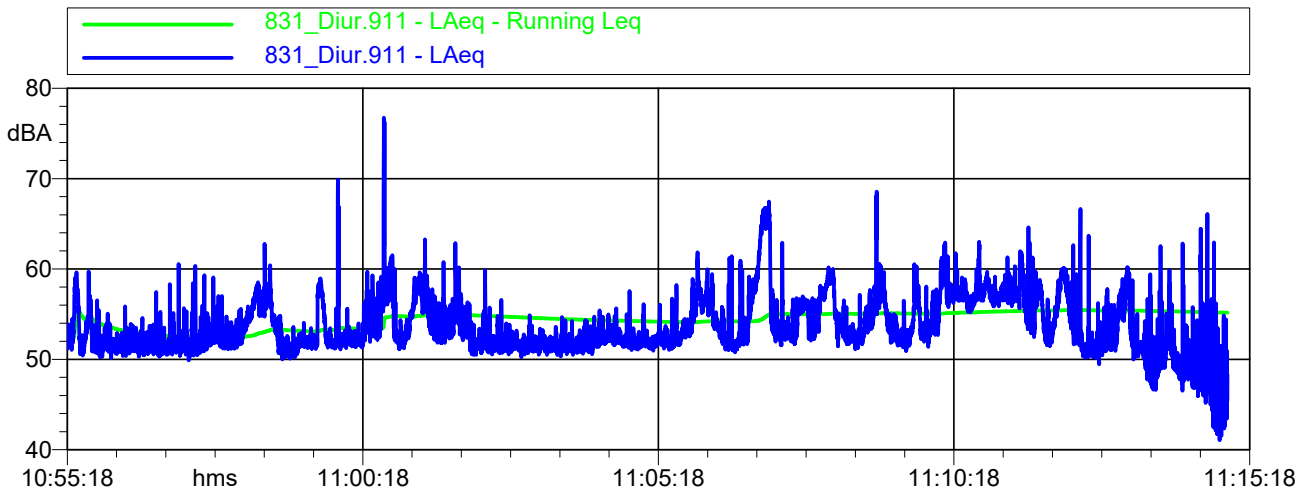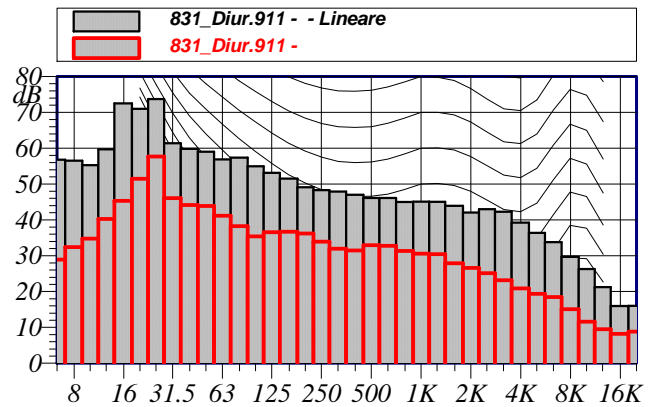



831_Diur.911 LAeq			
Nome	Inizio	Durata	Leq
Totale	10:55:18	00:19:37.500	55.2 dBA
Non Mascherato	10:55:18	00:19:37.500	55.2 dBA
Mascherato		00:00:00	0.0 dBA

Nome misura: 831_Diur.912
Località: MARONE (BS)
Strumentazione: 831 0004327
Durata misura [s]: 1244.9
Nome operatore: DOTT. ANDREA BREVIARIO
Data, ora misura: 12/14/2021

831_Diur.912 - Lineare					
dB		dB		dB	
6.3 Hz	59.4 dB	100 Hz	54.9 dB	1600 Hz	43.4 dB
8 Hz	55.6 dB	125 Hz	54.1 dB	2000 Hz	40.2 dB
10 Hz	55.4 dB	160 Hz	50.5 dB	2500 Hz	38.9 dB
12.5 Hz	60.8 dB	200 Hz	50.2 dB	3150 Hz	36.8 dB
16 Hz	71.1 dB	250 Hz	49.2 dB	4000 Hz	33.8 dB
20 Hz	67.0 dB	315 Hz	50.1 dB	5000 Hz	29.1 dB
25 Hz	66.5 dB	400 Hz	49.4 dB	6300 Hz	24.6 dB
31.5 Hz	65.3 dB	500 Hz	47.5 dB	8000 Hz	19.2 dB
40 Hz	60.6 dB	630 Hz	49.3 dB	10000 Hz	13.2 dB
50 Hz	60.6 dB	800 Hz	48.8 dB	12500 Hz	10.9 dB
63 Hz	57.4 dB	1000 Hz	47.0 dB	16000 Hz	9.8 dB
80 Hz	55.0 dB	1250 Hz	44.3 dB	20000 Hz	12.5 dB

Valori statistici	
L1: 62.2 dBA	L90: 53.9 dBA
L5: 58.7 dBA	L95: 53.7 dBA
L50: 54.9 dBA	L99: 53.3 dBA

$L_{Aeq} = 55.8 \text{ dB}$

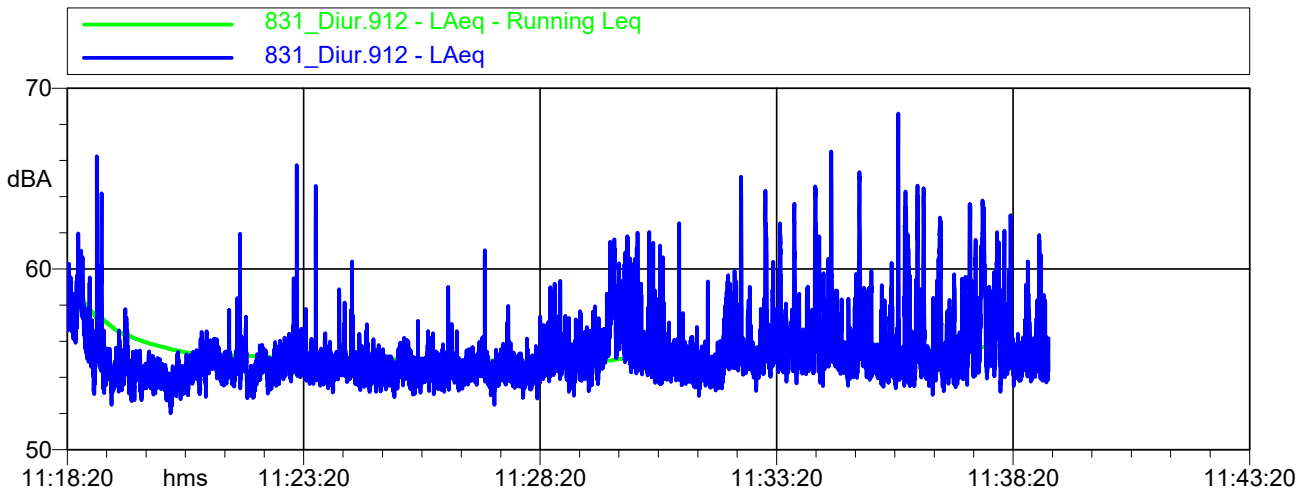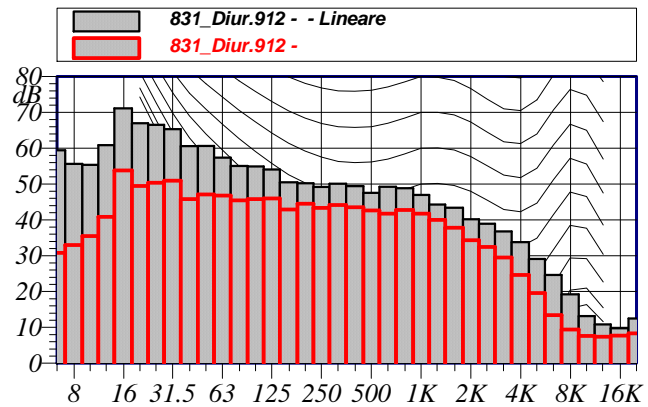



831_Diur.912 LAeq			
Nome	Inizio	Durata	Leq
Totale	11:18:20	00:20:44.900	55.8 dBA
Non Mascherato	11:18:20	00:20:44.900	55.8 dBA
Mascherato		00:00:00	0.0 dBA

Nome misura: 831_Diur.913
Località: MARONE (BS)
Strumentazione: 831 0004327
Durata misura [s]: 1243.7
Nome operatore: DOTT. ANDREA BREVIARIO
Data, ora misura: 12/14/2021

831_Diur.913 - Lineare					
dB		dB		dB	
6.3 Hz	51.1 dB	100 Hz	53.6 dB	1600 Hz	47.1 dB
8 Hz	50.0 dB	125 Hz	50.7 dB	2000 Hz	44.8 dB
10 Hz	50.9 dB	160 Hz	52.1 dB	2500 Hz	43.1 dB
12.5 Hz	58.5 dB	200 Hz	48.1 dB	3150 Hz	41.6 dB
16 Hz	63.2 dB	250 Hz	49.4 dB	4000 Hz	41.2 dB
20 Hz	64.9 dB	315 Hz	47.8 dB	5000 Hz	36.9 dB
25 Hz	65.0 dB	400 Hz	47.0 dB	6300 Hz	35.2 dB
31.5 Hz	57.0 dB	500 Hz	48.0 dB	8000 Hz	33.2 dB
40 Hz	57.0 dB	630 Hz	48.5 dB	10000 Hz	28.5 dB
50 Hz	58.7 dB	800 Hz	50.0 dB	12500 Hz	23.7 dB
63 Hz	57.7 dB	1000 Hz	50.7 dB	16000 Hz	19.2 dB
80 Hz	56.6 dB	1250 Hz	49.0 dB	20000 Hz	14.6 dB

Valori statistici	
L1: 69.7 dBA	L90: 47.9 dBA
L5: 64.6 dBA	L95: 47.7 dBA
L50: 50.3 dBA	L99: 47.3 dBA

$L_{Aeq} = 57.9$ dB

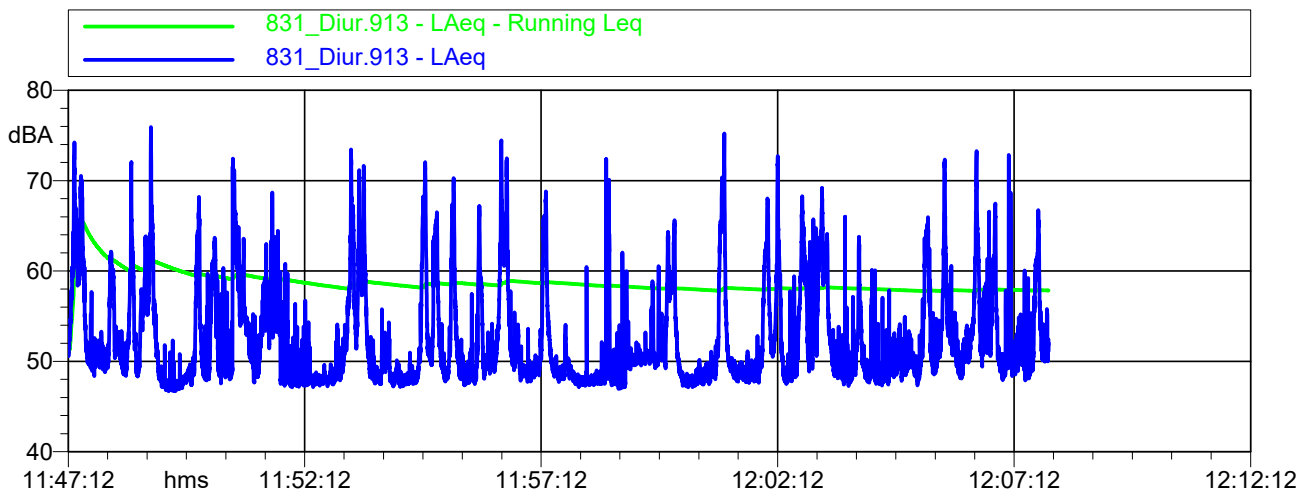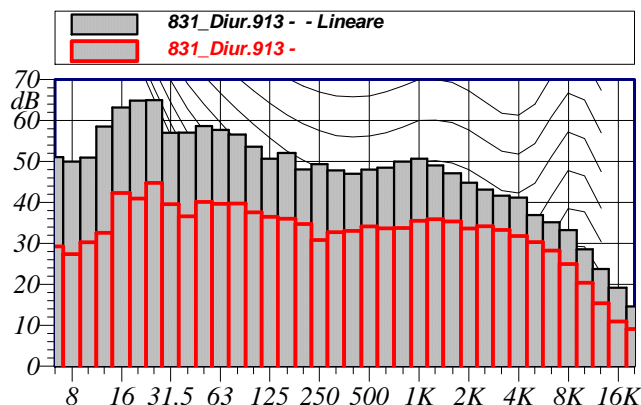



831_Diur.913 LAeq			
Nome	Inizio	Durata	Leq
Totale	11:47:12	00:20:43.700	57.9 dBA
Non Mascherato	11:47:12	00:20:43.700	57.9 dBA
Mascherato		00:00:00	0.0 dBA

Nome misura: 831_Diur.914
Località: MARONE (BS)
Strumentazione: 831 0004327
Durata misura [s]: 1210.3
Nome operatore: DOTT. ANDREA BREVIARIO
Data, ora misura: 12/14/2021

831_Diur.914 - Lineare					
dB		dB		dB	
6.3 Hz	51.4 dB	100 Hz	47.5 dB	1600 Hz	40.9 dB
8 Hz	49.2 dB	125 Hz	45.1 dB	2000 Hz	42.0 dB
10 Hz	48.7 dB	160 Hz	45.0 dB	2500 Hz	39.0 dB
12.5 Hz	53.4 dB	200 Hz	41.9 dB	3150 Hz	36.8 dB
16 Hz	56.7 dB	250 Hz	42.4 dB	4000 Hz	35.8 dB
20 Hz	62.6 dB	315 Hz	42.2 dB	5000 Hz	33.0 dB
25 Hz	60.8 dB	400 Hz	42.7 dB	6300 Hz	29.8 dB
31.5 Hz	56.4 dB	500 Hz	45.4 dB	8000 Hz	26.5 dB
40 Hz	49.4 dB	630 Hz	45.2 dB	10000 Hz	22.3 dB
50 Hz	49.8 dB	800 Hz	43.3 dB	12500 Hz	16.4 dB
63 Hz	50.9 dB	1000 Hz	40.7 dB	16000 Hz	11.3 dB
80 Hz	50.4 dB	1250 Hz	42.2 dB	20000 Hz	11.0 dB

Valori statistici	
L1: 61.7 dBA	L90: 42.4 dBA
L5: 57.5 dBA	L95: 42.1 dBA
L50: 45.1 dBA	L99: 41.5 dBA

$L_{Aeq} = 52.2$ dB

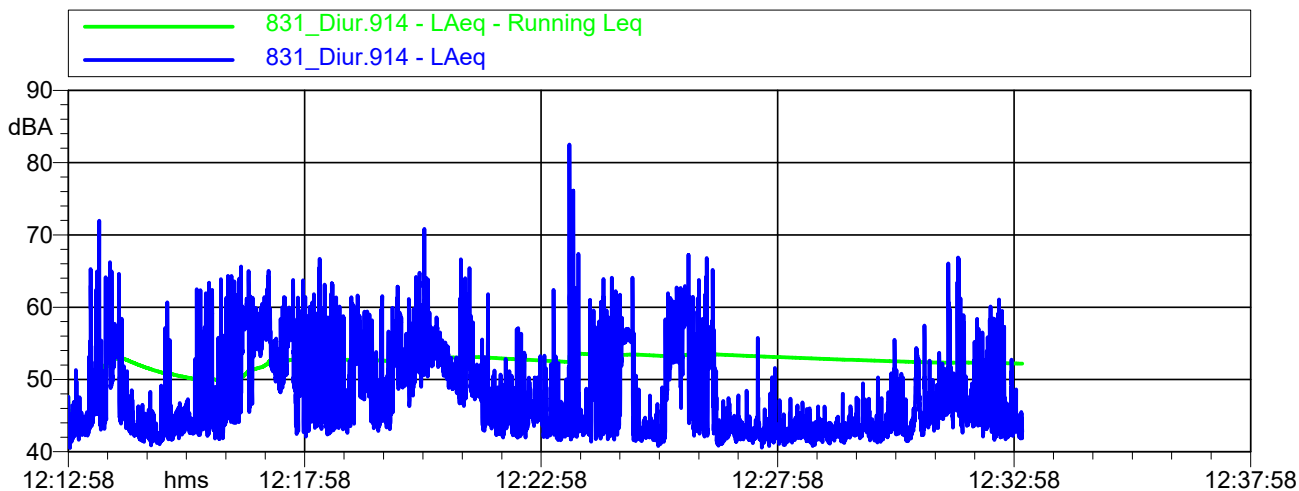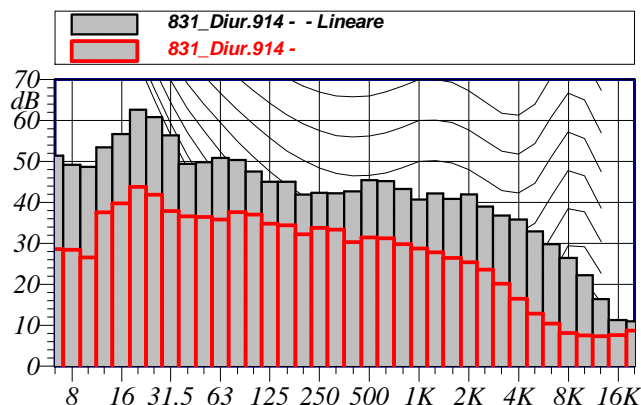



831_Diur.914 LAeq			
Nome	Inizio	Durata	Leq
Totale	12:12:58	00:20:10.299	52.2 dBA
Non Mascherato	12:12:58	00:20:10.299	52.2 dBA
Mascherato		00:00:00	0.0 dBA

Nome misura: 831_Diur.915
Località: MARONE (BS)
Strumentazione: 831 0004327
Durata misura [s]: 1200.1
Nome operatore: DOTT. ANDREA BREVIARIO
Data, ora misura: 12/14/2021

831_Diur.915 - Lineare					
dB		dB		dB	
6.3 Hz	50.9 dB	100 Hz	53.6 dB	1600 Hz	46.3 dB
8 Hz	47.4 dB	125 Hz	49.4 dB	2000 Hz	44.3 dB
10 Hz	48.3 dB	160 Hz	49.4 dB	2500 Hz	41.5 dB
12.5 Hz	53.3 dB	200 Hz	48.6 dB	3150 Hz	40.7 dB
16 Hz	56.9 dB	250 Hz	48.1 dB	4000 Hz	38.7 dB
20 Hz	58.7 dB	315 Hz	46.6 dB	5000 Hz	36.4 dB
25 Hz	59.1 dB	400 Hz	46.4 dB	6300 Hz	34.9 dB
31.5 Hz	57.3 dB	500 Hz	46.3 dB	8000 Hz	32.1 dB
40 Hz	58.3 dB	630 Hz	47.0 dB	10000 Hz	28.1 dB
50 Hz	60.4 dB	800 Hz	48.1 dB	12500 Hz	23.8 dB
63 Hz	58.6 dB	1000 Hz	48.5 dB	16000 Hz	20.7 dB
80 Hz	57.2 dB	1250 Hz	47.1 dB	20000 Hz	14.6 dB

Valori statistici	
L1: 69.6 dBA	L90: 40.2 dBA
L5: 61.4 dBA	L95: 39.2 dBA
L50: 46.1 dBA	L99: 38.2 dBA

$L_{Aeq} = 56.3$ dB

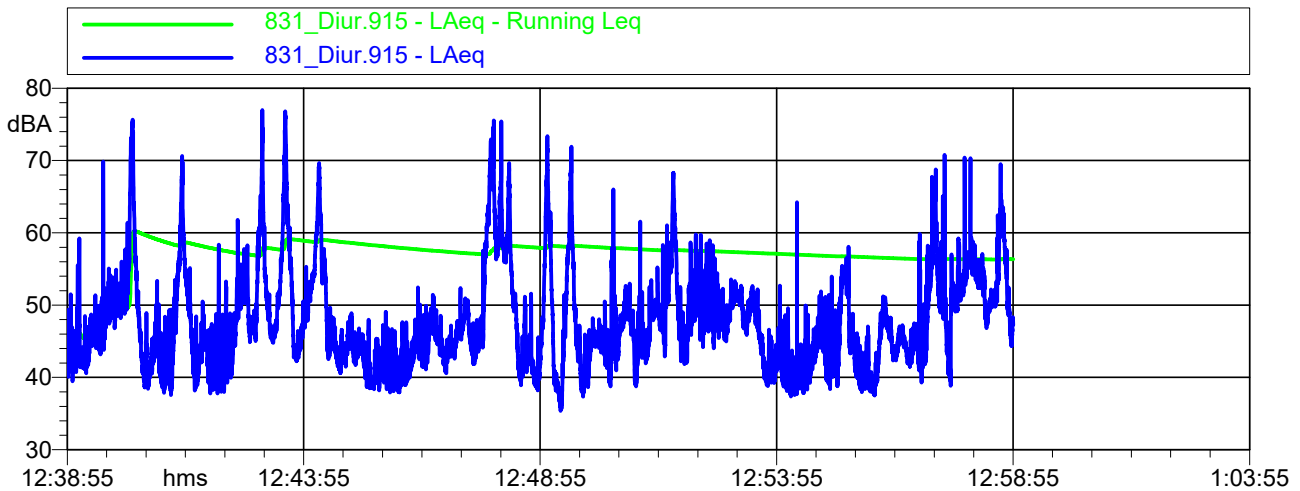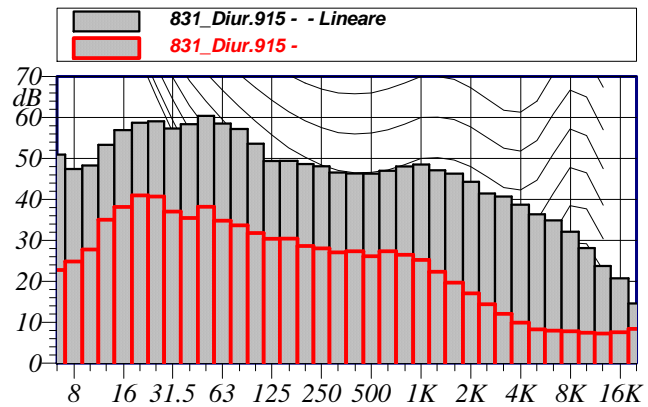



831_Diur.915 LAeq			
Nome	Inizio	Durata	Leq
Totale	12:38:55	00:20:00.100	56.3 dBA
Non Mascherato	12:38:55	00:20:00.100	56.3 dBA
Mascherato		00:00:00	0.0 dBA

Nome misura: 831_Diur.916
Località: MARONE (BS)
Strumentazione: 831 0004327
Durata misura [s]: 1201.7
Nome operatore: DOTT. ANDREA BREVIARIO
Data, ora misura: 12/14/2021

831_Diur.916 - Lineare					
dB		dB		dB	
6.3 Hz	53.3 dB	100 Hz	43.4 dB	1600 Hz	34.2 dB
8 Hz	48.8 dB	125 Hz	41.1 dB	2000 Hz	32.2 dB
10 Hz	50.0 dB	160 Hz	40.1 dB	2500 Hz	30.6 dB
12.5 Hz	52.7 dB	200 Hz	40.7 dB	3150 Hz	29.0 dB
16 Hz	56.3 dB	250 Hz	38.0 dB	4000 Hz	28.2 dB
20 Hz	57.3 dB	315 Hz	37.9 dB	5000 Hz	26.0 dB
25 Hz	59.9 dB	400 Hz	40.1 dB	6300 Hz	24.8 dB
31.5 Hz	52.1 dB	500 Hz	40.5 dB	8000 Hz	21.9 dB
40 Hz	50.9 dB	630 Hz	38.7 dB	10000 Hz	18.0 dB
50 Hz	51.6 dB	800 Hz	37.3 dB	12500 Hz	14.3 dB
63 Hz	48.3 dB	1000 Hz	36.4 dB	16000 Hz	11.6 dB
80 Hz	45.0 dB	1250 Hz	35.7 dB	20000 Hz	10.8 dB

Valori statistici	
L1: 55.7 dBA	L90: 37.9 dBA
L5: 51.0 dBA	L95: 37.2 dBA
L50: 42.2 dBA	L99: 36.2 dBA

$L_{Aeq} = 46.1$ dB

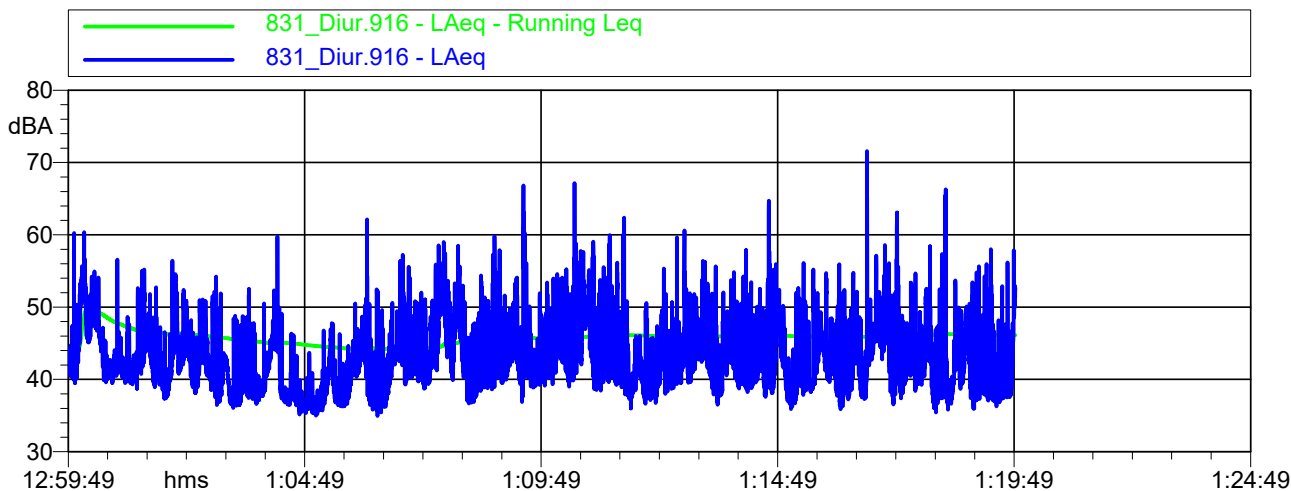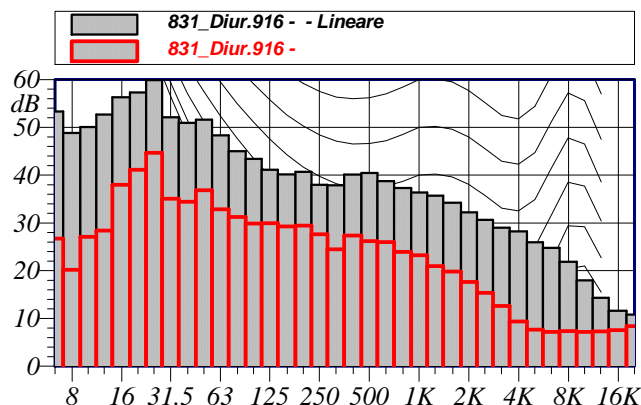



831_Diur.916 LAeq			
Nome	Inizio	Durata	Leq
Totale	12:59:49	00:20:01.700	46.1 dBA
Non Mascherato	12:59:49	00:20:01.700	46.1 dBA
Mascherato		00:00:00	0.0 dBA

Nome misura: 831_Diur.917
Località: MARONE (BS)
Strumentazione: 831 0004327
Durata misura [s]: 1345.5
Nome operatore: DOTT. ANDREA BREVIARIO
Data, ora misura: 12/14/2021

831_Diur.917 - Lineare					
dB		dB		dB	
6.3 Hz	47.5 dB	100 Hz	53.4 dB	1600 Hz	53.9 dB
8 Hz	46.2 dB	125 Hz	52.7 dB	2000 Hz	50.0 dB
10 Hz	47.1 dB	160 Hz	52.0 dB	2500 Hz	47.5 dB
12.5 Hz	50.0 dB	200 Hz	51.9 dB	3150 Hz	44.7 dB
16 Hz	53.9 dB	250 Hz	53.5 dB	4000 Hz	41.6 dB
20 Hz	54.1 dB	315 Hz	52.1 dB	5000 Hz	38.2 dB
25 Hz	53.3 dB	400 Hz	52.4 dB	6300 Hz	35.9 dB
31.5 Hz	57.4 dB	500 Hz	54.9 dB	8000 Hz	32.3 dB
40 Hz	61.5 dB	630 Hz	53.9 dB	10000 Hz	28.3 dB
50 Hz	56.9 dB	800 Hz	55.2 dB	12500 Hz	30.5 dB
63 Hz	56.6 dB	1000 Hz	56.3 dB	16000 Hz	19.9 dB
80 Hz	52.7 dB	1250 Hz	55.4 dB	20000 Hz	14.2 dB

Valori statistici	
L1: 74.1 dBA	L90: 42.2 dBA
L5: 71.0 dBA	L95: 41.3 dBA
L50: 51.7 dBA	L99: 37.6 dBA

$L_{Aeq} = 63.3 \text{ dB}$

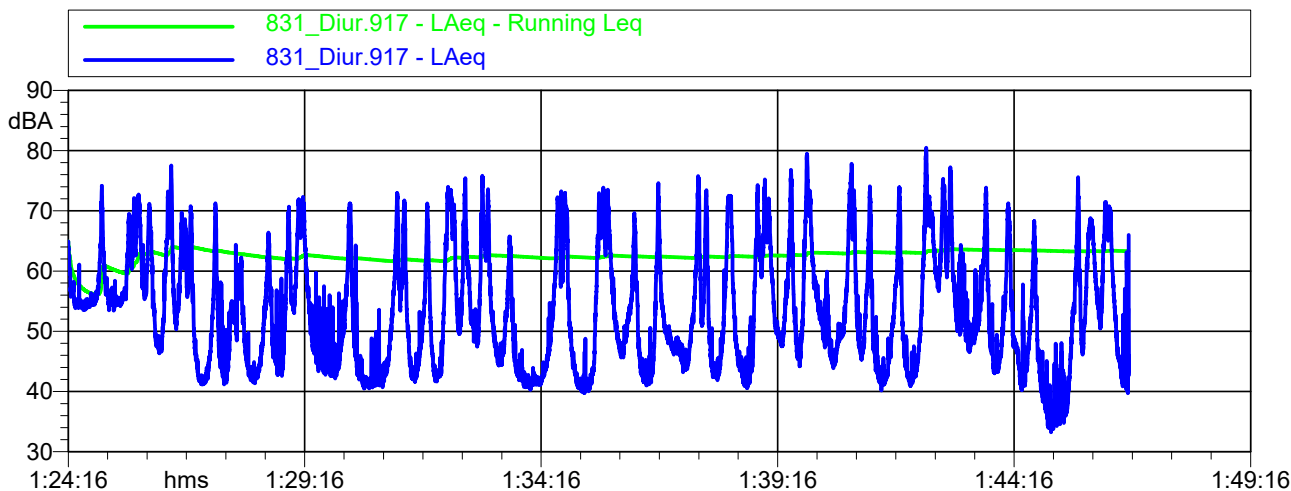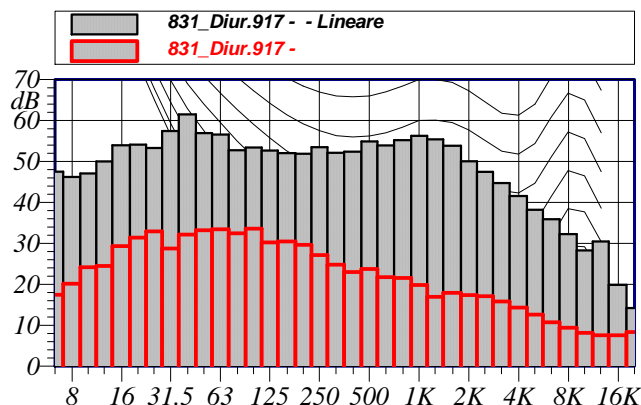



831_Diur.917 LAeq			
Nome	Inizio	Durata	Leq
Totale	1:24:16	00:22:25.500	63.3 dBA
Non Mascherato	1:24:16	00:22:25.500	63.3 dBA
Mascherato		00:00:00	0.0 dBA

Nome misura: 831_Diur.918
Località: MARONE (BS)
Strumentazione: 831 0004327
Durata misura [s]: 1221.8
Nome operatore: DOTT. ANDREA BREVIARIO
Data, ora misura: 12/14/2021

831_Diur.918 - Lineare					
dB		dB		dB	
6.3 Hz	48.0 dB	100 Hz	54.1 dB	1600 Hz	53.4 dB
8 Hz	46.8 dB	125 Hz	53.6 dB	2000 Hz	50.5 dB
10 Hz	49.2 dB	160 Hz	52.8 dB	2500 Hz	49.8 dB
12.5 Hz	52.4 dB	200 Hz	51.9 dB	3150 Hz	46.0 dB
16 Hz	56.3 dB	250 Hz	51.0 dB	4000 Hz	43.7 dB
20 Hz	56.7 dB	315 Hz	51.1 dB	5000 Hz	40.9 dB
25 Hz	61.4 dB	400 Hz	50.9 dB	6300 Hz	39.2 dB
31.5 Hz	57.5 dB	500 Hz	51.8 dB	8000 Hz	34.7 dB
40 Hz	59.1 dB	630 Hz	52.4 dB	10000 Hz	30.2 dB
50 Hz	59.8 dB	800 Hz	53.2 dB	12500 Hz	26.3 dB
63 Hz	60.7 dB	1000 Hz	55.2 dB	16000 Hz	21.7 dB
80 Hz	57.0 dB	1250 Hz	54.4 dB	20000 Hz	15.8 dB

Valori statistici	
L1: 71.6 dBA	L90: 45.2 dBA
L5: 68.6 dBA	L95: 43.5 dBA
L50: 56.9 dBA	L99: 41.6 dBA

$L_{Aeq} = 62.5$ dB

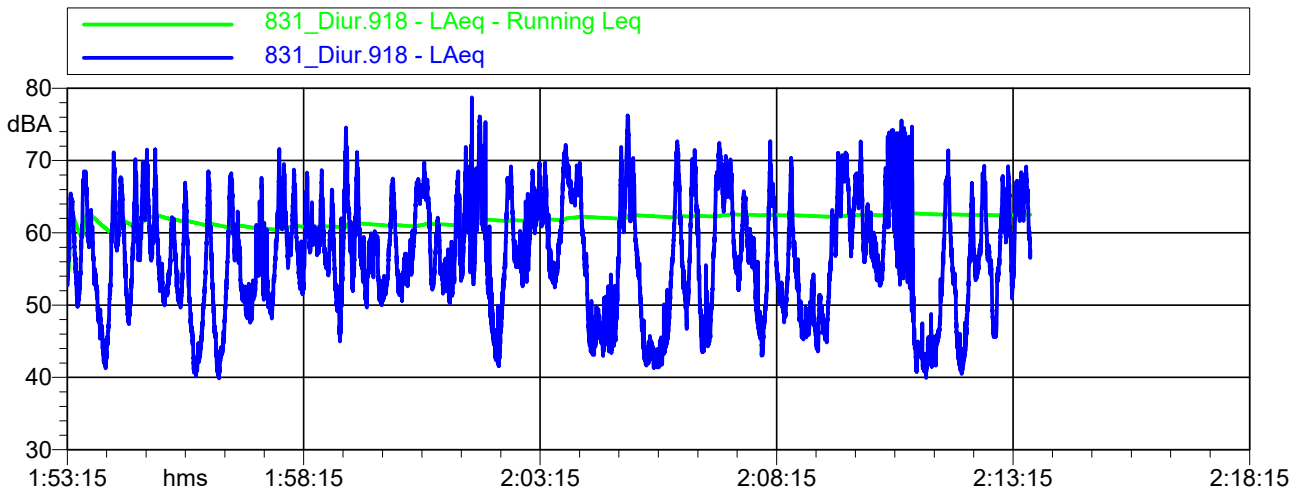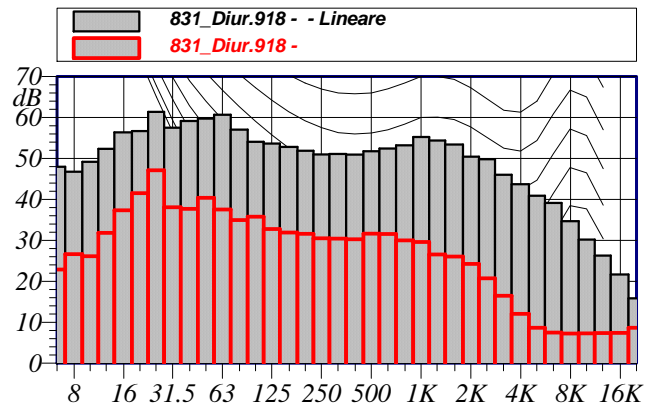



831_Diur.918 LAeq			
Nome	Inizio	Durata	Leq
Totale	1:53:15	00:20:21.799	62.5 dBA
Non Mascherato	1:53:15	00:20:21.799	62.5 dBA
Mascherato		00:00:00	0.0 dBA

Nome misura: 831_Diur.919
Località: MARONE (BS)
Strumentazione: 831 0004327
Durata misura [s]: 1203.2
Nome operatore: DOTT. ANDREA BREVIARIO
Data, ora misura: 12/14/2021

831_Diur.919 - Lineare					
dB		dB		dB	
6.3 Hz	46.3 dB	100 Hz	52.6 dB	1600 Hz	50.7 dB
8 Hz	46.9 dB	125 Hz	52.2 dB	2000 Hz	48.0 dB
10 Hz	50.9 dB	160 Hz	51.5 dB	2500 Hz	45.5 dB
12.5 Hz	55.0 dB	200 Hz	52.3 dB	3150 Hz	42.9 dB
16 Hz	58.8 dB	250 Hz	53.7 dB	4000 Hz	40.1 dB
20 Hz	61.0 dB	315 Hz	51.0 dB	5000 Hz	37.0 dB
25 Hz	60.3 dB	400 Hz	51.5 dB	6300 Hz	34.4 dB
31.5 Hz	58.6 dB	500 Hz	53.2 dB	8000 Hz	31.5 dB
40 Hz	60.8 dB	630 Hz	52.3 dB	10000 Hz	28.3 dB
50 Hz	62.9 dB	800 Hz	51.6 dB	12500 Hz	24.8 dB
63 Hz	60.0 dB	1000 Hz	52.6 dB	16000 Hz	20.7 dB
80 Hz	58.0 dB	1250 Hz	52.1 dB	20000 Hz	15.2 dB

Valori statistici	
L1: 70.5 dBA	L90: 46.9 dBA
L5: 66.7 dBA	L95: 45.8 dBA
L50: 54.4 dBA	L99: 44.8 dBA

$L_{Aeq} = 60.7$ dB

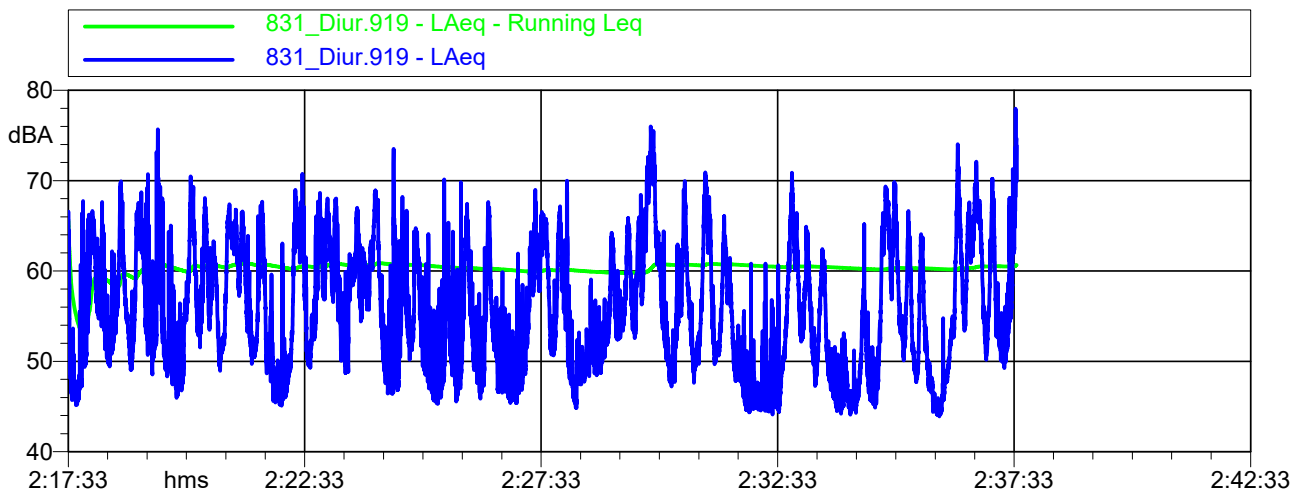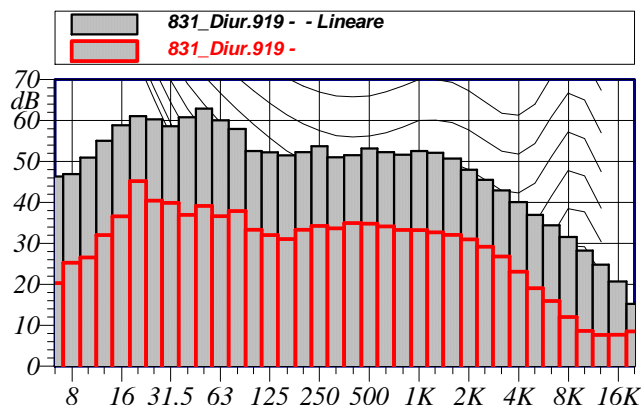

831_Diur.919 LAeq			
Nome	Inizio	Durata	Leq
Totale	2:17:33	00:20:03.200	60.7 dBA
Non Mascherato	2:17:33	00:20:03.200	60.7 dBA
Mascherato		00:00:00	0.0 dBA